


INITIAL PERMIT REVIEW

PERMITY PRICING REVISION

P.O. Böx. 820632 Houston Texas 77.

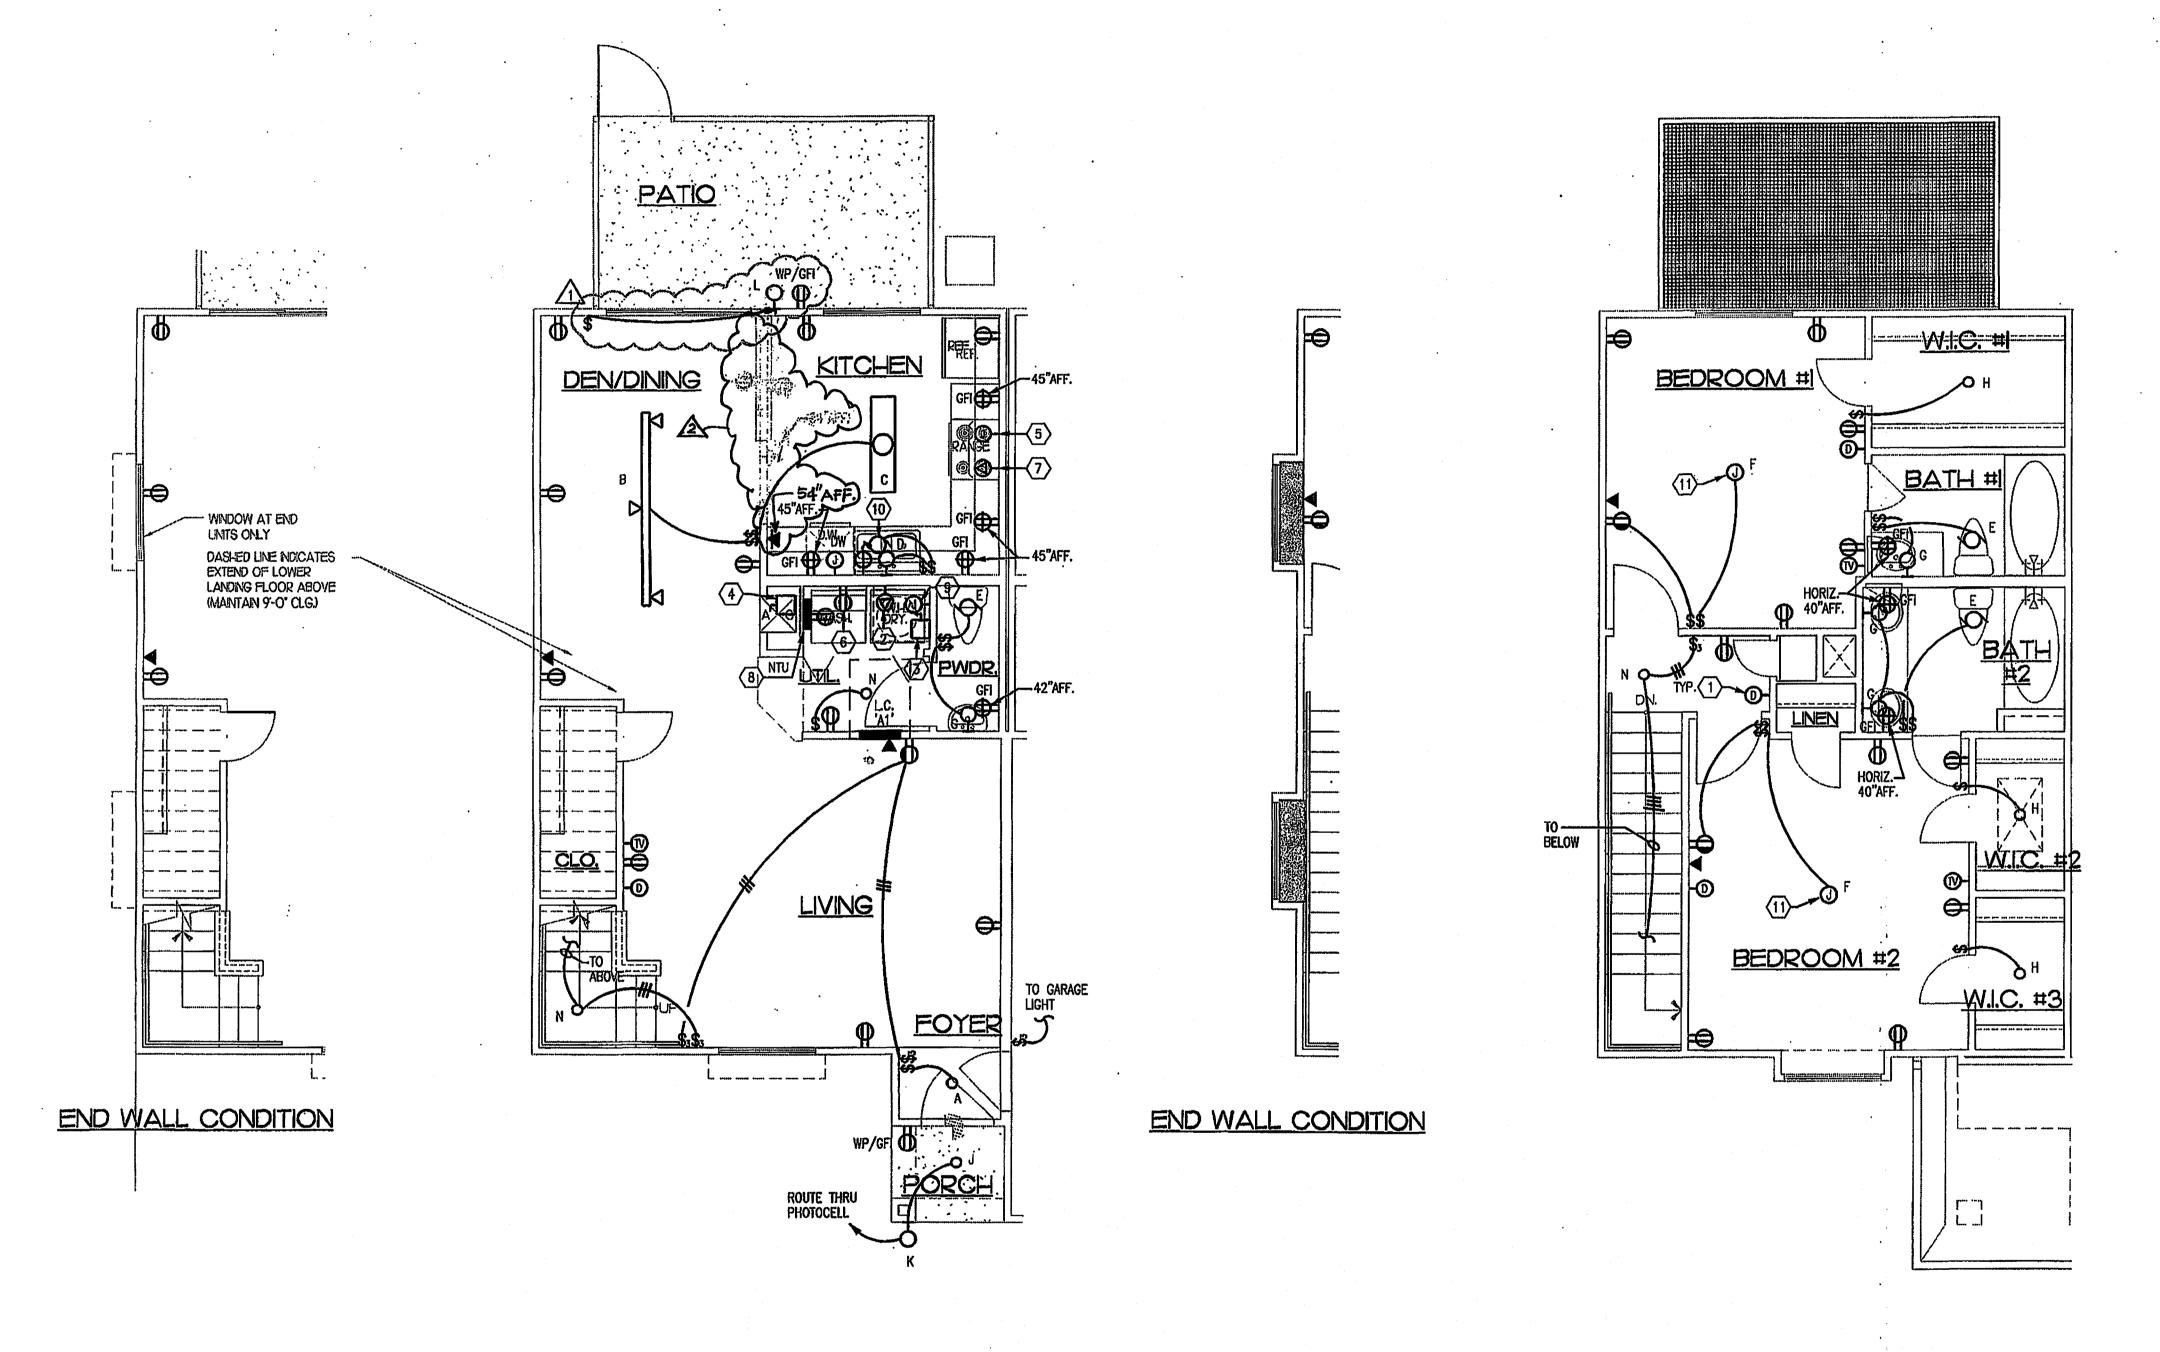

GENERAL NOTES:

- 1. REFER TO MECHANICAL EQUIPMENT CONNECTION SCHEDULE ON SHEET E-0.0 FOR ALL HVAC
- 2. ALL OUTLETS AT KITCHEN SINK AND BATH LAVATORY COUNTER TO BE GFI RATED.
- 3. REFER TO MECHANICAL PLANS FOR LOCATION(S) OF EQUIPMENT TO BE SERVED.
- 4. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION OF CONDENSING UNITS.
- 5. FOR HANDICAPPED UNITS, RANGE HOOD SWITCHES ARE TO BE MOUNTED 44" A.F.F.
- 6. SWITCH ALL BATH EXHAUST FANS INDEPENDENT
- 7. SWITCHED RECEPTACLES SHALL BE DONE SO

INDEPENDENT OF LIGHTS.

- 8. VERIFY LOCATION OF WATER HEATER AND INCOMING WATER SUPPLY LINE WITH PLUMBING CONTRACTOR.
- 9. UNLESS OTHERWISE NOTED, ALL WIRE SIZES TO BE #12.

KEY NOTES:

- SMOKE DETECTOR (120V) WITH SOUNDER AND BATTERY BACKUP.
- CONTRACTOR SHALL FURNISH AND INSTALL A NEMA 14-30R RECEPTACLE AND CIRCUIT OF 3#10, #10G. FOR DRYER. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT ACTUALLY FURNISHED.
- CONTRACTOR SHALL FURNISH AND INSTALL A 30 AMP, 2
 POLE, NEMA 1 DISCONNECT AND CIRCUIT OF 2#10, 1#10G.
 FOR FOR WATER HEATER. A LOCK-OFF CIRCUIT BREAKER
 MAY BE USED INSTEAD OF A DISCONNECT SWITCH WHERE
 APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- PROVIDE U.L. LISTED NEMA DISCONNECT TO AHU. SEE
 MECHANICAL EQUIPMENT CONNECTION SCHEDULE FOR
 ELECTRICAL INSTALLATION AND DISCONNECT REQUIREMENTS,
 SHEET EO.O. A LOCK-OFF CIRCUIT BREAKER MAY BE USED
 INSTEAD OF A DISCONNECT SWITCH WHERE APPROVED BY THE
 AUTHORITY HAVING JURISDICTION.
- CONTRACTOR SHALL FURNISH AND INSTALL A JUNCTION BOX AND CIRCUIT OF 2#12, #12G. FOR RANGE HOOD.
 COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT ACTUALLY
- 6 CONTRACTOR SHALL FURNISH AND INSTALL A NEMA 5-20R RECEPTACLE AND CIRCUIT OF 2#12, #12G. FOR WASHER. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT ACTUALLY
- CONTRACTOR SHALL FURNISH AND INSTALL A NEMA 14-50R RECEPTACLE AND CIRCUIT OF 3#6, #10g. FOR RANGE. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT ACTUALLY FURNISHED.
- CONTRACTOR SHALL FURNISH AND INSTALL A NETWORK TERMINAL UNIT FOR TERMINATION OF COMMUNICATION CABLES. PROVIDE RECEPTACLES FOR TELCO, METERING, SECURITY, AND ALL OTHER SYSTEMS AS REQUIRED. COORDINATE WITH ALL TRADES AND SUPPLIERS FOR REQUIREMENTS PRIOR TO ROUGH—IN.
- ONTRACTOR SHALL FURNISH AND INSTALL A JUNCTION BOX WITH CAT 5 CABLING FOR WATER SUB-METERING SYSTEM.
 COORDINATE EXACT REQUIREMENTS WITH PLUMBING CONTRACTOR PRIOR TO INSTALLATION.
- CONTRACTOR SHALL FURNISH AND INSTALL SWITCH AND SINGLE RECEPTACLE FOR CONNECTION OF DISPOSAL.
 RECEPTACLE MAY BE DELETED IF DISPOSAL IS DESIGNATED FOR HARDWIRED. ALL HANDICAP UNITS SHALL BE HARDWIRED WITH SWITCH MOUNTED IN FACE OF CABINET (SEE ARCHITECTURAL DRAWING FOR EXACT LOCATION)
- JUNCTION BOX SUPPORTED FROM STRUCTURE FOR CEILING

UNIT "A1" - Two Bedroom, 2 1/2 Bath

21 1/4" - 1"-0" FRST FLOOR PLAN - 621 ... 1,228 ... TOTAL

UNIT "A1" - Two Bedroom, 2 1/2 Bath

E2.1 1/4" - 1'-0" SECOND FLOOR PLAN - 607 ... 1,228 ... TOTAL

Jordan & Skala Engineers, Inc.

Job Number - OT10380

6030-P UNITY DRIVE, NDRCROSS, GA 30071
PHONE (770)447-5547 FAX (770)448-0262
EMAIL: Jos@Jordanskolo.com

COPYRIGHT © 2001 JORDAN & SKALA ENGINEERS INC.

COPYRIGHT 2001 The Barrington Group Incorporated

∞.