

Corporate & Mail

6400 Manatee Ave. W., Ste. C
Bradenton, FL 34209-2357
Tel. (941)-795-2399 • (800) 226-1735
Fax (941) 792-1735
E-mail: escinc@verizon.net



ENVIRONMENTAL SAFETY CONSULTANTS, INC.

Pinellas Office

13578 58th St. N., Ste. 207
Clearwater, FL 33760-3721
Tel. (727) 538-4154 • (800) 226-1735
Fax (941) 792-1735
Web Site: www.escflorida.com

March 26, 2014

Mr. John Delesline
President
DELESLINE CONSTRUCTION, INC.
320 7th Street West
Palmetto, Florida 34221

Re: Report of Results, Asbestos Survey
Chiropractic Office, 312 7th Street West
Palmetto, Manatee County, Florida

Dear Mr. Delesline:

Delesline Construction, Inc. (DLC) retained Environmental Safety Consultants, Inc. (ESC) to perform an Asbestos Survey of the above-referenced Building, which is scheduled for demolition. The objective was to determine if building materials contained asbestos, so proper procedures can be followed before demolition. The Survey was conducted by ESC's Accredited Asbestos Inspector, Mr. Christopher G. Stirrat, under my direction as ESC's Florida Licensed Asbestos Consultant (LAC).

The Asbestos Survey was completed on the date shown on the attached Physical Assessment Form to identify asbestos containing building materials (ACMs). A sampling strategy was developed to provide random samples of suspect ACMs. The sampling format was based on the U.S. Environmental Protection Agency's (EPA's) protocol stipulated in Part 763 in Title 40 of the Code of Federal Regulations (40 CFR 763). Each identified suspect ACM was assessed on friability (whether the material, when dry, could be crushed into a powder form and become airborne), condition, type, potential for damage, and accessibility. Upon conclusion of the visual inspection, ESC collected replicate bulk and quality control duplicate bulk samples of suspect ACMs.

The bulk samples were analyzed by an independent laboratory, which used polarized light microscopy (PLM) coupled with dispersion staining according to the EPA's Interim Method for the Determination of Asbestiform Minerals in Bulk Materials. The laboratory has successfully participated in the National Voluntary Laboratory Accreditation Program (NVLAP). Laboratory results showing more than one percent asbestos material are considered to be ACM by the EPA's regulations. The suspect ACMs are shown on the attached Physical Assessment Forms.

Delesline Construction, Inc., Report of Results,
Asbestos Survey, Chiropractic Office
Mr. John Delesline
March 26, 2014
Page 2

The samples were collected from the suspect materials identified on the attached Chain of Custody form and sent to Dove Environmental Corporation's (DEC's) laboratory for PLM analysis. The sampling station locations are shown on the attached Physical Assessment Form and Figure 1.

As shown by DEC's attached report, the quality control samples confirmed the integrity of the data and asbestos was detected in the four materials identified in Table 1. The ACMs were in good to fair condition (1-25% Damage) with a low to moderate potential for disturbance. The ACMs should be removed by a State-licensed Asbestos Contractor prior to demolition. All abatement must comply with the procedures stipulated in 29 CFR 1926.1101 and will be regulated by the EPA, U.S. Occupational Safety & Health Administration (OSHA), Florida Department of Environmental Protection (FDEP), Florida Department of Business & Professional Regulation (FDBPR), and U.S. Department of Transportation (DOT). A Notification Form must be completed and submitted to FDEP for compliance with the National Emission Standards for Hazardous Air Pollutants (NESHAPs) in advance of the abatement. Contact Mr. Max Grondahl at the FDEP Southwest District Office (Telephone No. 813-632-7600) for details on the Notification Form and to discuss abatement alternatives as far as NESHAPs goes. Even for those ACMs with less than 1% (<1%) asbestos, OSHA's Permissible Exposure Limit (PEL) must not be exceeded during disturbance of these materials or demolition of the building. A copy of this Report must be kept on site at all times. DLC should determine and comply with all other requirements of building departments, etcetera. **If any additional suspect ACMs are revealed during the work, DLC should stop work and have ESC test the material.**

ESC appreciates the opportunity to be of service to you on this project. If you should have any questions, please feel free to call.

ENVIRONMENTAL SAFETY CONSULTANTS, INC.
Asbestos Business No. ZA0000033

Attachment

Project No. 1449-0003

f:\corel\reports\results3.dlc.wpd

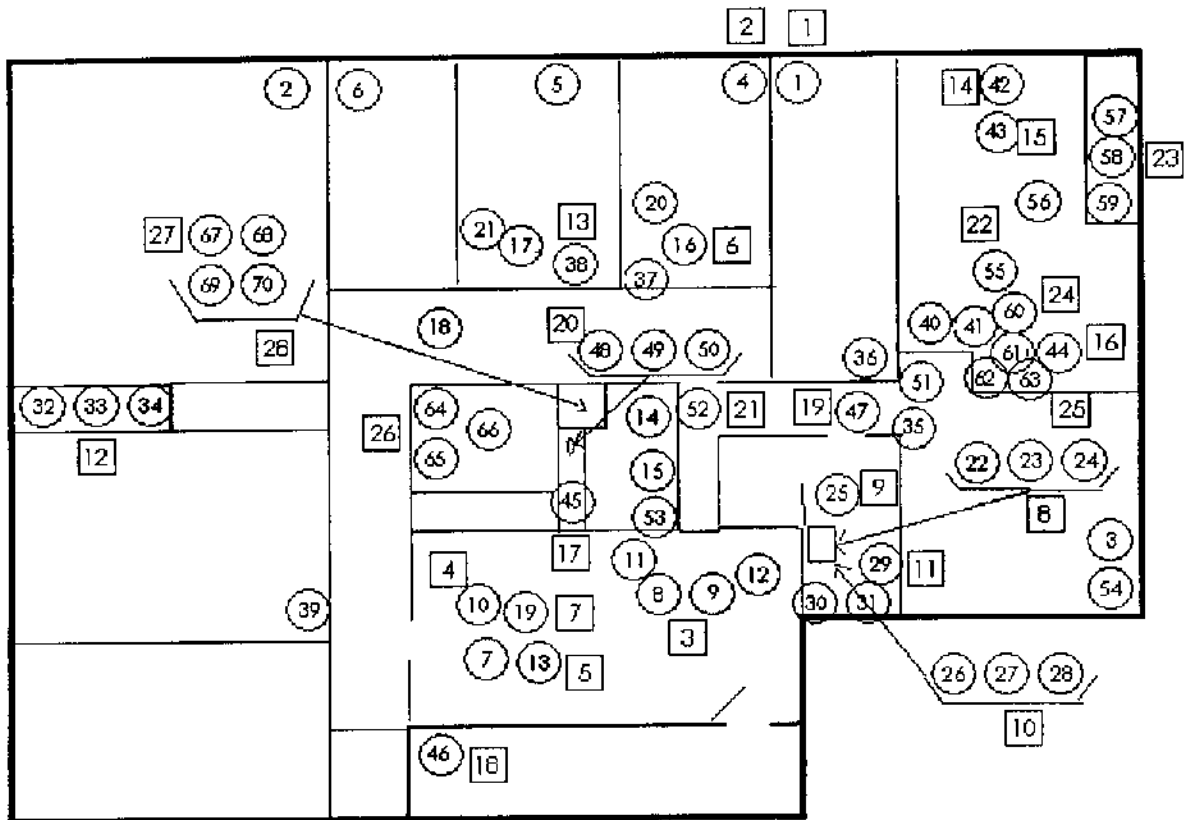


Table 1. Asbestos Containing Building Materials on March 18, 2014 in the Chiropractic Office, 312 7th Street West, Palmetto, Manatee County, Florida.

Homogeneous Group No.	Sample Numbers	Material	Location	Size ¹	Friable %	Asbestos	Condition/ % Damage	Potential for Disturbance
2	4, 5, 6	Gray/Black Rolled Roofing	Flat Portion of the Building Roof	250 ft ²	No	Chrysotile - <1%	Good 1-10%	Low
18	46	White Caulking	Exterior Window Frames and Siding Corners	35 ft ²	No	Chrysotile - 5%	Good 1-10%	Low
22	54, 55, 56	Tan 9-inch X 9-inch Floor Tile & Brown Mastic	Under Carpet in Storage Room, X-ray Room, & Back Office	600 ft ²	No	Chrysotile - <1% in Mastic Only	Good 1-10%	Low
24	60, 61, 62, 63	Green Linoleum & Mastic	South Side of Northeast Storage Room	18 ft ²	No	Chrysotile - 20% in Linoleum Felt Layer Only	Fair 10-25%	Moderate

NOTE: Sizes are only rough approximations. All sizes must be field verified before preparing abatement estimates or completing the abatement. Sizes are in square feet (ft²) or linear feet (ft).





LEGEND

- ① Asbestos Sample
- ② Homogeneous Group

Figure 1. Asbestos Sample Locations on March 18, 2014
 at Chiropractic Office, 312 7th Street West,
 Palmetto, Florida.

N
 ↑
 ───────────
 Not to Scale



REPORT OF RESULTS
ASBESTOS SURVEY
CHIROPRACTIC OFFICE
312 7TH STREET WEST
PALMETTO,
MANATEE COUNTY, FLORIDA
MARCH 26, 2014

Asbestos Inspector:

Christopher G. Stirrat, Environmental Safety Consultants, Inc.
Mayhew Environmental Training Associates
Certificate No. MECFF8F13D8CBF4C3
Expires 04/18/14

Christopher G. Stirrat
Signature

3/26/14
Date

Asbestos Consultant:

Scott A. Russell
Environmental Safety Consultants, Inc.
License No. AX66, Florida Department of
Business & Professional Regulation, Expires 11/30/14

Scott A. Russell
Signature

3/26/14
Date



CHAIN OF CUSTODY & PHYSICAL ASSESSMENT OF

Surveyor Christopher Shivers

Laboratory: Dave Environmental Corp.

SUSPECT ASBESTOS CONTAINING BUILDING MATERIALS

Signature of Surveyor [Signature]

Date: 3/12/14

Sample No	Elem. Group No.	Photo No.	Material		Friable	Size (ft ² or ft)	Con-dition	Freq. Contact	Vib's	Air Emission	Potential Disturb.
			Description	Type							
1213	1	100	Black/gray	Roofing shingles	N	1250 ft ²	G	L	L	L	L
1216	2	101	Gray Black	Roller Roofing Membrane	N	250 ft ²	G	L	L	L	L
1219	3	102	Black Silver	Insulation on H.V.A.C. Ductwork	N	10 ft ²	G	L	L	L	L
1211	4	103	White	C.T. #1 2x2'	Y	260 ft ²	G	L	L	L	L
1215	5	104	White Brown	C.T. #2 6'x6'	Y	400 ft ²	G	L	L	L	L
1217	6	105	White	C.T. #3 2'x2'	T	450 ft ²	G	L	L	L	L
1221	7	106	Pink Silver	H.V.A.C. Ductwork G' Room	Y	1200 ft ²	G	L	L	L	L
2413/14	8	107	White	H.V.A.C. Ductwork A/C Handler	N	200 ft ²	G	L	L	L	L

Relinquished by: ESC

Date/Time: 3/12/14 17:00 Received by: Dave Date/Time: 3/19/14 11:20

Remarks: Positive step on all homogeneous groups.

LEGEND:

Y = Yes
N = No

G = Good, 0-10% Damage
F = Fair, 10-25% Damage
P = Poor, >25% Damage

H = High
M = Moderate
L = Low

Project No. 9819145-0007 / Chippewa Office
 Laboratory: Dove Environmental Corp.

Surveyor: Chris Decker, Director
 Signature of Surveyor: [Signature]
 Date: 3/18/14

SUSPECT ASBESTOS CONTAINING BUILDING MATERIALS

Sample No.	Photo Group No.	Photo No.	Material		Friable	Size (ft ² or lin)	Con-dition	Freq. Contact	Vib's	Air Erosion	Potential Disturb.
			Description	Type							
25	9	107	White	HUMC Dust	N	200ft ²	G	L	L	L	
26, 27, 28	10	108	Yellow Silver	Mastic HVAC Square Duct Insulation	Y	28ft ²	G	L	L	L	
29, 30, 31	11	109	White Brown	EIF 4 6'x6'	Y	14ft ²	G	L	L	L	
32, 33, 34	12	110	Brown	Paneling Mastic	N	40ft ²	G	L	L	L	
35, 36, 37, 38, 39	13	111	White	Drywall + Jt Grout #1	Y	2800ft ²	G	L	L	L	
40, 41, 42	14	112	White	Drywall + Jt Grout #2	Y	3000ft ²	G	L	L	L	
43	15	112	White	Drywall + Jt Grout #3	Y	3000ft ²	G	L	L	L	
44	16	113	Pink Brown	Bath Insulation	Y	900ft ²	G	L	L	L	

Relinquished by ESC: [Signature] Date/Time: 3/18/14 1:52 PM Received by Dove: [Signature] Date/Time: 3/19/14 11:00 AM
 AISC (via FedEx)

Remarks: Positive for all homogeneous groups.

LEGEND: Y = Yes, N = No
 G = Good, 1-10% Damage, F = Fair, 10-25% Damage, P = Poor, >25% Damage
 H = High, M = Moderate, L = Low

Project No./Bldg. #/A - 6703/Chiropractic Office

Laboratory: Dove Environmental Corp.

Surveyor: Christopher A. Arnold

Signature of Surveyor: *[Signature]*

Date: 3/18/14

ENVIRONMENTAL SAFETY CONSULTANTS, INC.
CHAIN OF CUSTODY & PHYSICAL ASSESSMENT OF
SUSPECT ASBESTOS CONTAINING BUILDING MATERIALS

Sample No.	Home Group No.	Photo No.	Material		Fri-able	Size (ft ² or lin)	Con-dition	Freq. Contact	Vib's	Air Emission	Potential Disturb.
			Description	Type							
45	17	114	White	Sealant	N	600ft ²	G-	L	L	L	L
46	18	115	White	Caulkings	N	357ft ²	G-	L	L	L	L
47	19	116	Brown	Wool Batt/Insulation	N	305ft ²	G-	L	L	L	L
48, 49, 50	20	117	White	Sink U.C.	N	4ft ²	G-	L	L	L	L
51, 52, 53	21	118	Brown/Black	Carpet Mastic	N	1200ft ²	G-	L	L	L	L
54, 55, 56	22	119	Tan/Black	FL. #1, 9" x 9" Mastic	N	600ft ²	G-	L	L	L	L
57, 58, 59	23	120	Gray/Brown	FL. #1, 2" x 8" Mastic	N	12ft ²	F	M	M	M	M
60, 61, 62	24	121	Green	Linoleum + Mastic	N	18ft ²	F	M	M	M	M

Relinquished by: ESC *[Signature]* Date/Time: 3/18/14 17:00 Received by: Dove *[Signature]* Date/Time: 3/18/14 17:00

Remarks: Replicate step on all homogeneous surfaces.

LEGEND: Y = Yes, N = No, G = Good, 1-10% Damage, H = High, F = Fair, 30-25% Damage, M = Moderate, P = Poor, >25% Damage, L = Low



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAI

PAGE : 1
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 01
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BLACK/GRAY ROOFING SHINGLES
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE
 NON FIBERS : 20% MINERALS

SAMPLE NO.: 1
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 60% BITUMEN

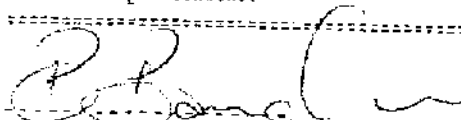
LAB NO. : 02
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BLACK/GRAY ROOFING SHINGLES
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE
 NON FIBERS : 20% MINERALS


SAMPLE NO.: 2
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 60% BITUMEN

LAB NO. : 03
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BLACK/GRAY ROOFING SHINGLES
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE
 NON FIBERS : 20% MINERALS

SAMPLE NO.: 3
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 60% BITUMEN

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EEA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 638-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 2
 DATE : 03/20/14
 SAMPLE ID : B403230

NVLAP Lab Code: 102053-0

LAB NO. : 04
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : GRAY ROLLED ROOFING & BLACK MASTIC
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 19.5% CELLULOSE
 NON FIBERS : 20% MINERALS

SAMPLE NO.: 4
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 50% RESINS


LAB NO. : 05
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : GRAY ROLLED ROOFING & BLACK MASTIC
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 19.5% CELLULOSE
 NON FIBERS : 20% MINERALS


SAMPLE NO.: 5
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 50% RESINS

LAB NO. : 06
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : GRAY ROLLED ROOFING & BLACK MASTIC
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 19.5% CELLULOSE
 NON FIBERS : 20% MINERALS

SAMPLE NO.: 6
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 50% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 163 Subpart F App. EPA/600/R-93/115. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-File is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Rammath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C,
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAE

PAGE : 3
 DATE : 03/20/14
 SAMPLE ID : 0403230

NVLAP Lab Code: 102053-0

LAB NO. : 07
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : BLACK INSULATION ON HVAC & SILVER DIFFUSER VENT
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% FIBER-GLASS
 NON FIBERS : 20% MINERALS
 10% RESINS

SAMPLE NO.: 7
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 08
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : BLACK INSULATION ON HVAC & SILVER DIFFUSER VENT
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% FIBER-GLASS
 NON FIBERS : 20% MINERALS
 10% RESINS

SAMPLE NO.: 8
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 09
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : BLACK INSULATION ON HVAC & SILVER DIFFUSER VENT
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% FIBER-GLASS
 NON FIBERS : 20% MINERALS
 10% RESINS

SAMPLE NO.: 9
 DATE OF ANALYSIS: 03/20/14

=====

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.

=====

B. Pander
 Analyst 1

R. Pepe Ramnath
 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 638-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STARRAT

PAGE : 4
 DATE : 03/20/14
 SAMPLE ID : 0403230

NVLAP Lab Code: 102053-0

LAB NO. : 10
 FRI/HOM : YES/YES LAYERS: 01
 DESCRIPTION : WHITE C.T. #1, 2'X2'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 15% CELLULOSE
 15% MINERAL WOOL
 NON FIBERS : 10% MINERALS
 5% PERLITES

SAMPLE NO.: 10
 DATE OF ANALYSIS: 03/20/14
 40% FIBER-GLASS
 10% PAINT
 5% GLASS-SHOTS


LAB NO. : 11
 FRI/HOM : YES/YES LAYERS: 01
 DESCRIPTION : WHITE C.T. #1, 2'X2'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 15% CELLULOSE
 15% MINERAL WOOL
 NON FIBERS : 10% MINERALS
 5% PERLITES


SAMPLE NO.: 11
 DATE OF ANALYSIS: 03/20/14
 40% FIBER-GLASS
 10% PAINT
 5% GLASS-SHOTS


LAB NO. : 12
 FRI/HOM : YES/YES LAYERS: 01
 DESCRIPTION : WHITE C.T. #1, 2'X2'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 15% CELLULOSE
 15% MINERAL WOOL
 NON FTBERS : 10% MINERALS
 5% PERLITES

SAMPLE NO.: 12
 DATE OF ANALYSIS: 03/20/14
 40% FIBER-GLASS
 10% PAINT
 5% GLASS-SHOTS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. B2A/B3B/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Raminath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 5
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 13
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE/BROWN C.T. #2, 6"X6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 13
 DATE OF ANALYSIS: 03/20/14

10% PAINT

LAB NO. : 14
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE/BROWN C.T. #2, 6"X6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 14
 DATE OF ANALYSIS: 03/20/14

10% PAINT

LAB NO. : 15
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE/BROWN C.T. #2, 6"X6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS


SAMPLE NO.: 15
 DATE OF ANALYSIS: 03/20/14


10% PAINT


=====

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.

=====


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 5910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C,
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 6
 DATE : 03/20/14
 SAMPLE ID : 0403230

NVLAP Lab Code: 102053-0

LAB NO. : 16
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE C.T. #3 2'x4'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 40% CELLULOSE
 15% MINERAL WOOL
 NON FIBERS : 10% MINERALS
 5% PERLITES

SAMPLE NO.: 16
 DATE OF ANALYSIS: 03/20/14
 15% FIBER-GLASS
 10% PAINT
 5% GLASS-SHOTS


LAB NO. : 17
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE C.T. #3 2'x4'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 40% CELLULOSE
 15% MINERAL WOOL
 NON FIBERS : 10% MINERALS
 5% PERLITES

SAMPLE NO.: 17
 DATE OF ANALYSIS: 03/20/14
 15% FTBER-GLASS
 10% PAINT
 5% GLASS-SHOTS


LAB NO. : 18
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE C.T. #3 2'x4'
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 40% CELLULOSE
 15% MINERAL WOOL
 NON FIBERS : 10% MINERALS
 5% PERLITES

SAMPLE NO.: 18
 DATE OF ANALYSIS: 03/20/14
 15% FIBER-GLASS
 10% PAINT
 5% GLASS-SHOTS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. ZPA/600/R-53/116. Measurement Uncertainty Information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAI

PAGE : 7
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 19 SAMPLE NO.: 19
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : PINK HVAC DUCT INSULATION & SILVER 6" ROUND
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE 85% FIBER-GLASS
 NON FIBERS : 5% MINERALS 5% RESINS

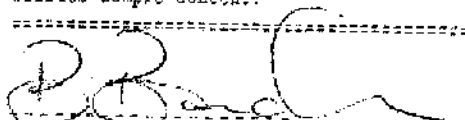
LAB NO. : 20 SAMPLE NO.: 20
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : PINK HVAC DUCT INSULATION & SILVER 6" ROUND
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE 85% FIBER-GLASS
 NON FIBERS : 5% MINERALS 5% RESINS


LAB NO. : 21 SAMPLE NO.: 21
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : PINK HVAC DUCT INSULATION & SILVER 6" ROUND
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE 85% FIBER-GLASS
 NON FIBERS : 5% MINERALS 5% RESINS

=====

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. BPA/600/R-53/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.

=====


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT. CHRISTOPHER STRAAT

PAGE : 8
 DATE : 03/20/14
 SAMPLE ID : B403230

NVLAP Lab Code: 102053-0

LAB NO. : 22
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : WHITE HVAC DUCT MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS

SAMPLE NO.: 22
 DATE OF ANALYSIS: 03/20/14

90% POLYMERS

LAB NO. : 23
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : WHITE HVAC DUCT MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS

SAMPLE NO.: 23
 DATE OF ANALYSIS: 03/20/14


90% POLYMERS


LAB NO. : 24
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : WHITE HVAC DUCT MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS

SAMPLE NO.: 24
 DATE OF ANALYSIS: 03/20/14

90% POLYMERS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/2-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 9
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 25
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : WHITE HVAC DUCT MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS
 90% POLYMERS

SAMPLE NO.: 25
 DATE OF ANALYSIS: 03/20/14


LAB NO. : 26
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : YELLOW HVAC SQUARE & SILVER DUCT INSULATION
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 10% RESINS
 70% FIBER-GLASS

SAMPLE NO.: 26
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 27
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : YELLOW HVAC SQUARE & SILVER DUCT INSULATION
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 10% RESINS
 70% FIBER-GLASS

SAMPLE NO.: 27
 DATE OF ANALYSIS: 03/20/14

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 49 CFR Part 761 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C,
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT


PAGE : 10
 DATE : 03/20/14
 SAMPLE ID : 0403230
 NVLAP Lab Code: 102053-0


LAB NO. : 28 SAMPLE NO.: 28
 FRI/HOM : YES/NO LAYERS: 02 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : YELLOW HVAC SQUARE & SILVER DUCT INSULATION
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE 70% FIBER-GLASS
 NON FIBERS : 10% RESTINS

LAB NO. : 29 SAMPLE NO.: 29
 FRI/HOM : YES/NO LAYERS: 02 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : WHITE/BROWN C.T. #4, 6"X6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS 10% PAINT

LAB NO. : 30 SAMPLE NO.: 30
 FRI/HOM : YES/NO LAYERS: 02 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : WHITE/BROWN C.T. #4, 6"X6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS 10% PAINT

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Rannath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 11
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 31
 FRI/HOM : YES/NO LAYERS: 02
 DESCRIPTION : WHITE/BROWN C.T. #4, 6"x6"
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 80% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 31
 DATE OF ANALYSIS: 03/20/14

10% PAINT

LAB NO. : 32
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BROWN PANELING MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 32
 DATE OF ANALYSIS: 03/20/14


20% RESINS


LAB NO. : 33
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BROWN PANELING MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 33
 DATE OF ANALYSIS: 03/20/14

20% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRKAT

PAGE : 12

DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 34
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BROWN PANELING MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 70% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 34
 DATE OF ANALYSIS: 03/20/14
 20% RESINS

LAB NO. : 35
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #1
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 65% MINERALS

SAMPLE NO.: 35
 DATE OF ANALYSIS: 03/20/14
 5% FIBER-GLASS
 10% PAINT


LAB NO. : 36
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #1
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 65% MINERALS

SAMPLE NO.: 36
 DATE OF ANALYSIS: 03/20/14
 5% FIBER-GLASS
 10% PAINT

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. BPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.

Analyst 1

R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C,
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 13
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 37
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #1
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 65% MINERALS

SAMPLE NO.: 37
 DATE OF ANALYSIS: 03/20/14

5% FIBER-GLASS
 10% PAINT

LAB NO. : 38
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #1
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 65% MINERALS

SAMPLE NO.: 38
 DATE OF ANALYSIS: 03/20/14


5% FIBER-GLASS
 10% PAINT

LAB NO. : 39
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #1
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 65% MINERALS

SAMPLE NO.: 39
 DATE OF ANALYSIS: 03/20/14

5% FIBER-GLASS
 10% PAINT

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPL/608/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 14
 DATE : 03/20/14
 SAMPLE ID : 0403230

NVLAP Lab Code: 102053-G

LAB NO. : 40
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #2
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 60% MINERALS

SAMPLE NO.: 40
 DATE OF ANALYSIS: 03/20/14

10% FIBER-GLASS
 10% PAINT

LAB NO. : 41
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #2
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 60% MINERALS

SAMPLE NO.: 41
 DATE OF ANALYSIS: 03/20/14


10% FIBER-GLASS
 10% PAINT


LAB NO. : 42
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CMPD. #2
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 60% MINERALS

SAMPLE NO.: 42
 DATE OF ANALYSIS: 03/20/14

10% FIBER-GLASS
 10% PAINT

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 15
 DATE : 03/20/14
 SAMPLE ID : D403230


NVLAP Lab Code: 102053-0


LAB NO. : 43
 FRI/HOM : YES/NO LAYERS: 03
 DESCRIPTION : WHITE DRYWALL & JT. CPD. #2
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 60% MINERALS
 SAMPLE NO.: 43
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 10% PAINT

LAB NO. : 44
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : PINK/BROWN BATT INSULATION
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 10% MINERALS
 SAMPLE NO.: 44
 DATE OF ANALYSIS: 03/20/14
 50% FIBER-GLASS
 20% RESINS

LAB NO. : 45
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : WHITE CAULK
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS :
 NON FIBERS : 100 % POLYMERS
 SAMPLE NO.: 45
 DATE OF ANALYSIS: 03/20/14

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 16
 DATE : 03/20/14
 SAMPLI ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 46
 FRI/HOM : NO/NO
 DESCRIPTION : WHITE CAULK
 ASBESTOS TYPE: 5% CHRYSOTILE
 OTHER FIBERS : 2% CELLULOSE
 NON FIBERS : 55% MINERALS
 30% POLYMERS

LAYERS: 02

SAMPLE NO.: 46
 DATE OF ANALYSIS: 03/20/14

8% PAINT

LAB NO. : 47
 FRI/HOM : NO/NO
 DESCRIPTION : BROWN VINYL B.B. & MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 1% CELLULOSE
 NON FIBERS : 10% MINERALS
 80% POLYMERS

LAYERS: 02

SAMPLE NO.: 47
 DATE OF ANALYSIS: 03/20/14

9% RESINS

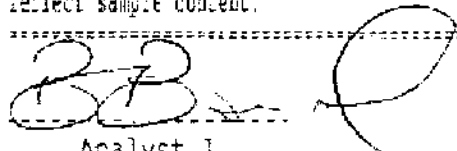
LAB NO. : 48
 FRI/HOM : NO/YES
 DESCRIPTION : WHITE SINK U.C.
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS

LAYERS: 01

SAMPLE NO.: 48
 DATE OF ANALYSIS: 03/20/14

90% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. E3A/600/E-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAIT

PAGE : 17
 DATE : 03/20/14
 SAMPLE ID : D403230

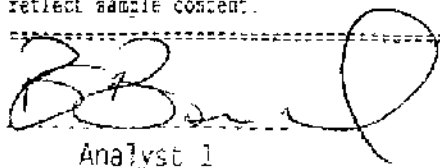
NVLAP Lab Code: 102053-0

LAB NO. : 49 SAMPLE NO.: 49
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : WHITE SINK U.C.
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS 90% RESINS

LAB NO. : 50 SAMPLE NO.: 50
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : WHITE SINK U.C.
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 5% CELLULOSE
 NON FIBERS : 5% MINERALS 90% RESINS

LAB NO. : 51 SAMPLE NO.: 51
 FRI/HOM : NO/YES LAYERS: 01 DATE OF ANALYSIS: 03/20/14
 DESCRIPTION : BROWN/BLACK CARPET MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE 50% SYNTHETIC
 NON FIBERS : 10% MINERALS 30% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 18
 DATE : 03/20/14
 SAMPLE ID : 0403230

NVLAP Lab Code: 102053-0

LAB NO. : 52
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BROWN/BLACK CARPET MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE
 NON FIBERS : 10% MINERALS

SAMPLE NO.: 52
 DATE OF ANALYSIS: 03/20/14
 50% SYNTHETIC
 30% RESINS


LAB NO. : 53
 FRI/HOM : NO/YES LAYERS: 01
 DESCRIPTION : BROWN/BLACK CARPET MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 10% CELLULOSE
 NON FIBERS : 10% MINERALS


SAMPLE NO.: 53
 DATE OF ANALYSIS: 03/20/14
 50% SYNTHETIC
 30% RESINS

LAB NO. : 54
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : TAN F.T. #1, 9"X9" & BROWN MASTIC
 TILE=NO, MASTIC=<1% CHRYSOTILE
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 4.5 % CELLULOSE
 NON FIBERS : 50% MINERALS
 10% RESINS

SAMPLE NO.: 54
 DATE OF ANALYSIS: 03/20/14
 35% POLYMERS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 163 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT
 ADDRESS : 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT : 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT : CHRISTOPHER STARRAT

PAGE : 19
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 55
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : TAN F.T. #1, 9"X9" & BROWN MASTIC
 TILE=NO. MASTIC=<1% CHRYSOTILE
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 4.5 % CELLULOSE
 NON FIBERS : 50% MINERALS
 10% RESINS

SAMPLE NO.: 55
 DATE OF ANALYSIS: 03/20/14

35% POLYMERS

LAB NO. : 56
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : TAN F.T. #1, 9"X9" & BROWN MASTIC
 TILE=NO. MASTIC=<1% CHRYSOTILE
 ASBESTOS TYPE: <1% CHRYSOTILE
 OTHER FIBERS : 4.5 % CELLULOSE
 NON FIBERS : 50% MINERALS
 10% RESINS

SAMPLE NO.: 56
 DATE OF ANALYSIS: 03/20/14

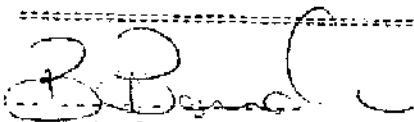
35% POLYMERS


LAB NO. : 57
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : GRAY F.T. #2, 9"X9" & BROWN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 2% CELLULOSE
 NON FIBERS : 53% MINERALS
 35% POLYMERS

SAMPLE NO.: 57
 DATE OF ANALYSIS: 03/20/14

10% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Kamnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 20
 DATE : 03/20/14
 SAMPLE ID : 0403230

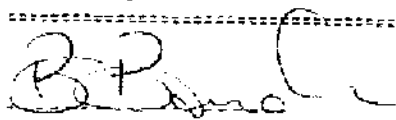
NVLAP Lab Code: 102053-0

LAB NO. : 58
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : GRAY F.T. #2, 9"X9" & BROWN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 2% CELLULOSE
 NON FIBERS : 53% MINERALS
 35% POLYMERS
 10% RESINS
 SAMPLE NO.: 58
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 59
 FRI/HOM : NO/NO LAYERS: 02
 DESCRIPTION : GRAY F.T. #2, 9"X9" & BROWN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 2% CELLULOSE
 NON FIBERS : 53% MINERALS
 35% POLYMERS
 10% RESINS
 SAMPLE NO.: 59
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 60
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : GREEN LINOLEUM & MASTIC
 FELT LAYER=20% CHRYSOTILE
 ASBESTOS TYPE: 20% CHRYSOTILE
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 15% MINERALS
 10% RESINS
 5% FIBER-GLASS
 30% POLYMERS
 SAMPLE NO.: 60
 DATE OF ANALYSIS: 03/20/14

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 21
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 61
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : STOP @ 1ST POSITIVE
 ASBESTOS TYPE:
 OTHER FIBERS :
 NON FIBERS :

SAMPLE NO.: 61
 DATE OF ANALYSIS: 03/20/14

LAB NO. : 62
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : STOP @ 1ST POSITIVE
 ASBESTOS TYPE:
 OTHER FIBERS :
 NON FIBERS :

SAMPLE NO.: 62
 DATE OF ANALYSIS: 03/20/14


LAB NO. : 63
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : GREEN LINOLEUM & TAN MASTIC
 FELT LAYER=20% CHRYSOTILE
 ASBESTOS TYPE: 20% CHRYSOTILE
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 15% MINERALS
 10% RESINS

SAMPLE NO.: 63
 DATE OF ANALYSIS: 03/20/14
 5% FIBER-GLASS
 30% POLYMERS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. 800/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results related only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.

Analyst 1

R. Pepe Rammath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 22
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 64
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 35% MINERALS
 10% RESINS

SAMPLE NO.: 64
 DATE OF ANALYSIS: 03/20/14

5% FIBER GLASS
 30% POLYMERS

LAB NO. : 65
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 35% MINERALS
 10% RESINS

SAMPLE NO.: 65
 DATE OF ANALYSIS: 03/20/14

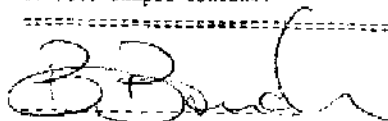
5% FIBER-GLASS
 30% POLYMERS

LAB NO. : 66
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 35% MINERALS
 10% RESINS

SAMPLE NO.: 66
 DATE OF ANALYSIS: 03/20/14

5% FIBER-GLASS
 30% POLYMERS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 90 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our Laboratory uses various microscopes and is NVLAP accredited. Floor-tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
 8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
 Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT,
 ADDRESS: 6400 MANATEE AVE. W. SUITE C.
 BRADENTON, FL 34209
 PROJECT: 1449-0003
 CHIROPRACTIC OFFICE
 CONSULT: CHRISTOPHER STIRRAT

PAGE : 23
 DATE : 03/20/14
 SAMPLE ID : D403230

NVLAP Lab Code: 102053-0

LAB NO. : 67
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 25% MINERALS
 35% POLYMERS

SAMPLE NO.: 67
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 10% RESINS


LAB NO. : 68
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 25% MINERALS
 35% POLYMERS

SAMPLE NO.: 68
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 10% RESINS

LAB NO. : 69
 FRI/HOM : NO/NO LAYERS: 03
 DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
 ASBESTOS TYPE: NONE-DETECTED
 OTHER FIBERS : 20% CELLULOSE
 NON FIBERS : 25% MINERALS
 35% POLYMERS

SAMPLE NO.: 69
 DATE OF ANALYSIS: 03/20/14
 10% FIBER-GLASS
 10% RESINS

Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/R-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analysed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-Tile is non-homogeneous and results only reflect sample content.


 Analyst 1


 R. Pepe Ramnath, PhD
 LABORATORY MANAGER



DOVE ENVIRONMENTAL CORP.
8910 MIRAMAR PARKWAY, SUITE 200 MIRAMAR FL 33025
Tel. (954) 374-9274 Fax: (954) 639-7426

ASBESTOS TEST REPORT

CLIENT : ENVIRONMENTAL SAFETY CONSULTANT.
ADDRESS: 6400 MANATEE AVE. W. SUITE C.
BRADENTON, FL 34209
PROJECT: 1449-0033
CHIROPRACTIC OFFICE
CONSULT: CHRISTOPHER STIRRAT

PAGE : 24
DATE : 03/20/14
SAMPLE ID : D40323C


NVLAP Lab Code: 102053-0

LAB NO. : 70
FRI/HOM : NO/NO LAYERS: 03
DESCRIPTION : YELLOW LINOLEUM & TAN MASTIC
ASBESTOS TYPE: NONE-DETECTED
OTHER FIBERS : 20% CELLULOSE
NON FIBERS : 25% MINERALS
35% POLYMERS

SAMPLE NO.: 70
DATE OF ANALYSIS: 03/20/14

10% FIBER-GLASS
10% RESINS

.....
Dove Environmental Corporation is solely responsible for analysis performed on sample content supplied by client and method 40 CFR Part 763 Subpart F App. EPA/600/P-93/116. Measurement Uncertainty information is available by contacting the Laboratory. Laboratory Reports will be kept for a period of three (3) years electronically. Percentages are visually estimated. Point count performed at clients request only. Results relates only to item analyzed. This report should not be reproduced by client or anyone without written permission from Dove Environmental Corporation. All samples will be stored for a period of 1 month. Our laboratory uses various microscopes and is NVLAP accredited. Floor-tile is non-homogeneous and results only reflect sample content.
.....


Analyst 1


R. Pepe Ramnath, PhD
LABORATORY MANAGER